


# Conexión del controlador

**NH-2**

Pt-100 $\Omega$ TC	OUT-1 (30 mA) SSR	220 V	COORTE 1	COORTE 2	COORTE 3
1 2 3	4 5	6 7 8 9	10 11 12	13 14 15	
MODELO	Tipo de Instrumento	SENSOR	RANGO	NUMERO	
NH-2	CONTROLADOR	J-K-RTD	-50 + 950 $^{\circ}$ C		

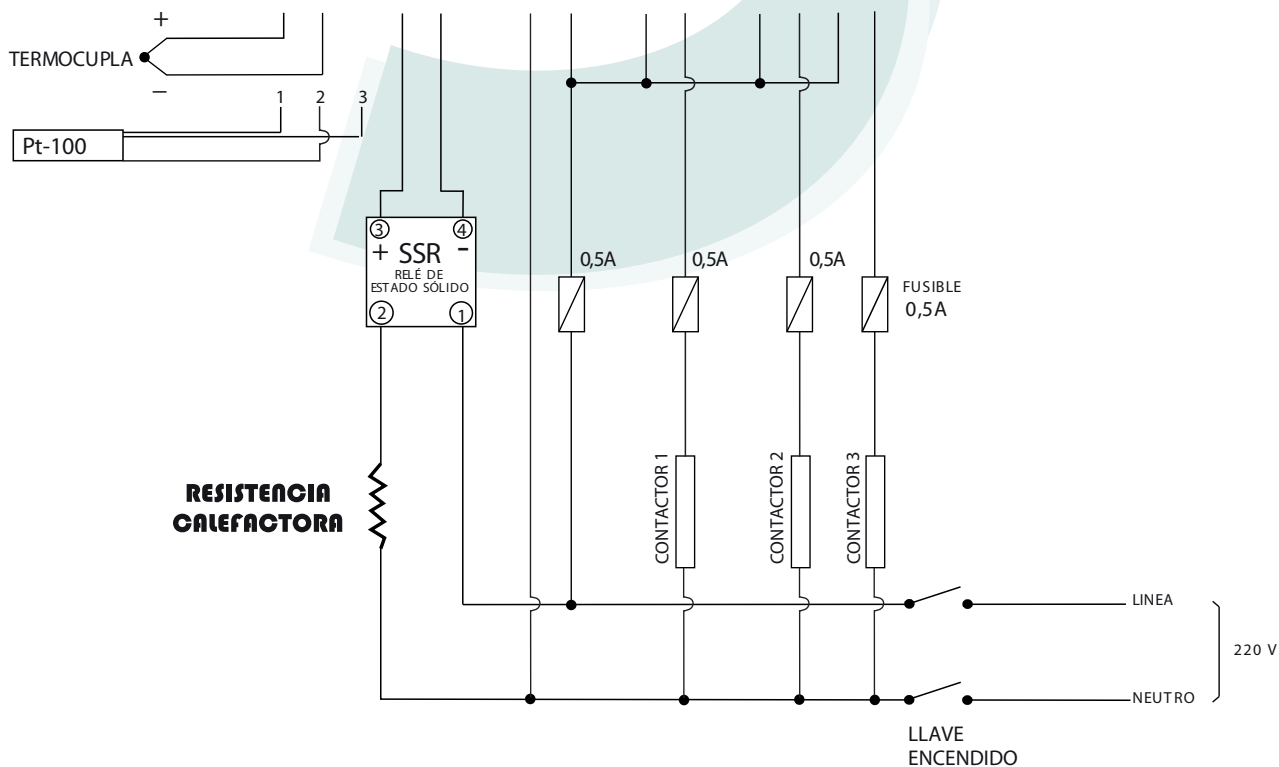

Revisión 01 | 07052021